


Low-Power Instrument Transformer (LPIT)

Technology for protection and metering


[siemens-energy.com/gas-insulated-switchgear](https://www.siemens-energy.com/gas-insulated-switchgear)

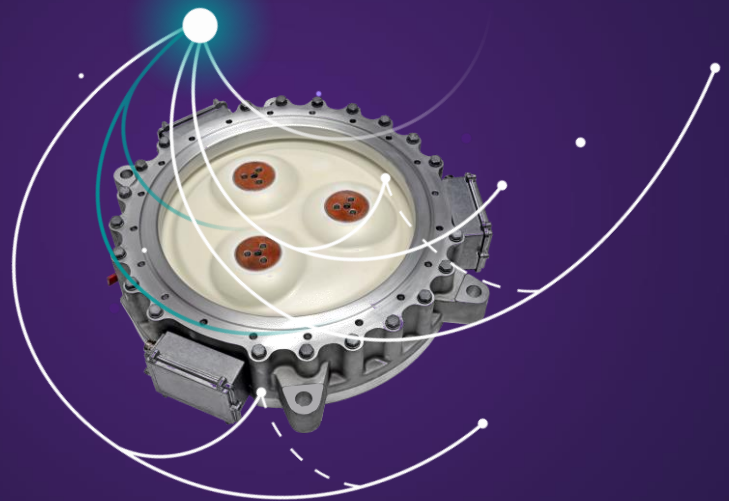

Description

Siemens Energy LPITs are innovative voltage and current transformers providing a safe, reliable and standardized solution for measurement and protection applications in GIS. Without saturation nor ferro-resonance phenomena, our LPIT provides a digital signal output signal acc. to IEC 61850-9-2 or can be plugged directly into a Siemens SIPROTEC 5 device.

The LPIT combines a Low Power Voltage Transformer (LPVT) and a Low Power Current Transformer (LPCT) fully compliant to the IEC 61869 series of standards. The measurement is based on Rogowski coils for current and capacitive voltage sensors. Both sensors are integrated in the same GIS cast resin partition.

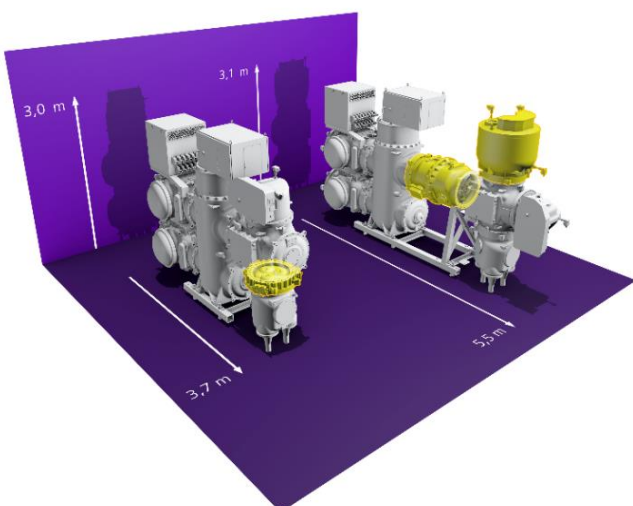

Benefits

- **Smaller size and weight of the GIS** due to smaller dimensions of the sensors and their integration into a GIS partition
- **Easy connection** and lower cabling and wiring effort
- **High reliability and long lifetime expectancy** due to the robust design of the sensors in the cast resin
- **Less insulation gas** in the switchgear
- Excellent overvoltage performance - **no need for disconnection** during GIS or HV cable tests
- **No hazardous overvoltage** at open terminals
- **A single LPIT covers all** protection and metering requirements and thanks to its linearity also a wide range of primary currents and voltages, simplifying stock management, engineering and logistics.
- **Flexible definition and modification** of the settings for rated primary current and voltage in SIPROTEC at any phase of the project and afterwards. In this way the GIS remains flexible for future increases of nominal current.

Furthermore, the LPIT sensors provide improved measurement performance due to high linearity, no saturation (unlike conventional CTs), no ferro-resonance effects (unlike conventional VT) and a wide frequency range for measuring harmonics up to the 50th harmonic frequency.

Merging unit

The SIPROTEC 6MU85 Merging Unit equipped with a dedicated Siemens Energy LPIT IO-card called IO240 provides a standardized digital output to connect non-Siemens protection relays.

When using SIPROTEC5 relays the IO240 can be plugged directly into the relay.

Differential protection schemes using both LPITs and conventional CT are possible.

Adapts to your requirements

- Digitalization of all primary data close to the process
- Integrated IO240 for GIS LPIT sensors
- Connection of conventional CT & VT and other types of LPIT feasible too
- Scalable number of binary inputs and outputs
- Point on wave switching and phasor measurement integrated
- Redundant power supply
- Time synchronization via IEEE 1588, PPS or IRIG-B
- Compliant to IEC 61869-9/-13 and IEC 61850-9-2
- Full support of IEC 61850-8-1 GOOSE

Benefits

- Minimize wiring by local installation (e.g. inside LCC)
- Easy extension: simply connect a new device to the process bus and get instant access to the measured values
- Maximum network reliability, through seamless redundancy protocols
- Interoperability ensured, standardized in IEC61869-9/-13 and IEC 61850-9-2
- Mixed installations with conventional and non-conventional CT/VT possible, e.g. for transformer differential protection



Merging Unit Siemens SIPROTEC 6MU85 flush mounted version

General	LPIT-145 (8DN8)	LPIT-145 (8VN1)	LPIT-170 (8DN8)
Rated insulation level	145 / 275 / 650 kV	145 / 275 / 650 kV	170 / 325 / 750 kV
Rated frequency f_r	50 Hz / 60 Hz	50 Hz / 60 Hz	50 Hz / 60 Hz
Rated short-time thermal current I_{th}	50 kA (3 s)	40 kA (3 s)	63 kA (3 s)
Temperature range	-30 °C / +55 °C	-30 °C / +55 °C	-30 °C / +55 °C
Weight	100 kg	185 kg	185 kg
Measurement of harmonics up to	50	50	50
Applied standard	IEC 61869	IEC 61869	IEC 61869
LPCT			
Rated primary current I_{pr}	200 A	200 A	200 A
Rated accuracy class	0.2S / 5P250 / 2TPM	0.2S / 5P200 / 2TPM	0.2S / 5P315 / 2TPM
Rated extended primary current factor K_{pcr}	15.75	15.75	20
Rated symmetrical short-circuit current factor K_{ssc}	250	200	315
LPVT			
Rated primary voltage U_{pr}	66 to 138 / $\sqrt{3}$ kV	66 to 138 / $\sqrt{3}$ kV	66 to 154 / $\sqrt{3}$ kV
Rated accuracy class LPCT	0.2 P	0.2 P	0.2 P
Rated voltage factor F_V and permissible duration	3 / 2000 h	3 / 2000 h	3 / 2000 h

Published by

Siemens Energy Global GmbH & Co. KG
Freyeslebenstraße 1
91058 Erlangen
Germany

For more information, please visit our website:
[siemens-energy.com/gas-insulated-switchgear](https://www.siemens-energy.com/gas-insulated-switchgear)
or contact us:
support.energy@siemens-energy.com
circuit-breakers@siemens-energy.com

© Siemens Energy, 2021

Siemens Energy is a trademark licensed by Siemens AG.

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract. All product designations may be trademarks or product names of Siemens Energy Global GmbH & Co. KG or other companies whose use by third parties for their own purposes could violate the rights of the owners.